



WITH TWO-WAY LEFT TURN LANE

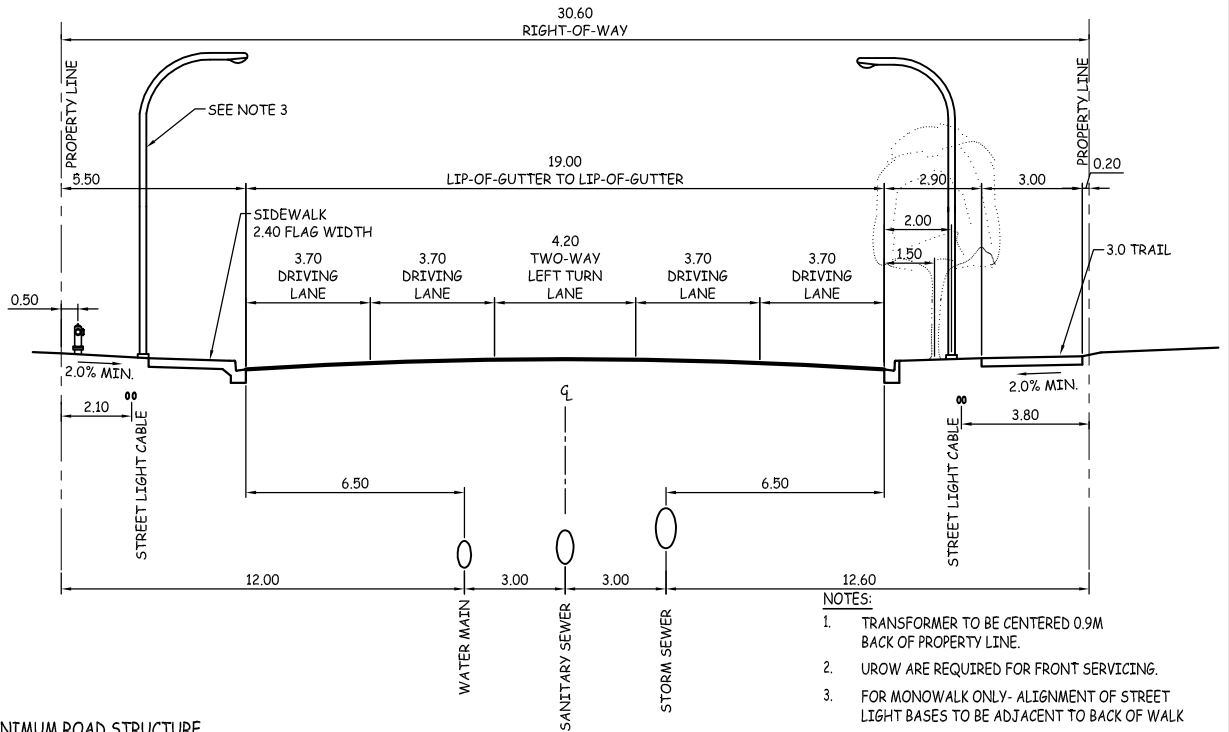

NOTES:

1. TRANSFORMER TO BE CENTERED 0.9M BACK OF PROPERTY LINE.
2. UROW ARE REQUIRED FOR FRONT SERVICING.
3. FOR MONOWALK ONLY - ALIGNMENT OF STREET LIGHT BASES TO BE ADJACENT TO BACK OF WALK
4. STREET LIGHT CABLES TO BE LOCATED AS SHOWN OR IN THE ELECTRICAL DISTRIBUTION TRENCH.
5. FOR SEPERATE SIDEWALK ONLY - FIRE HYDRANTS TO BE INSTALLED 1.50 METRES BEHIND LIP-OF-GUTTER (SAME ALIGNMENT AS TREE PLANTING)
6. ALL DIMENSTIONS IN METRES, UNLESS OTHERWISE NOTED.
7. RETROFIT ONLY. NOT ACCEPTABLE IN NEW DEVELOPMENTS.

MINIMUM ROAD STRUCTURE

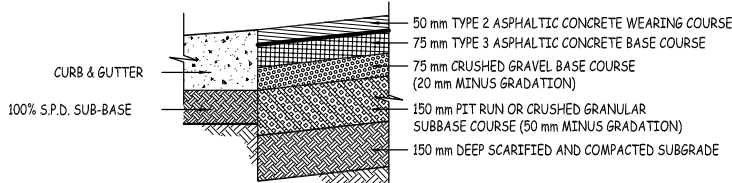

Authorized

Signature

Date

FILE: ROAD SECTIONS.DWG LAYOUT RD-107



Medicine Hat
The Gas City

Municipal Servicing Standard

UNDIVIDED ARTERIAL ROADWAY
WITH 2WLT(30.60m ROW-19.0m TW)
WITHOUT 2WLT(30.60m ROW-14.8m TW)

DWG NO. **RD-106**