




MONOLITHIC SIDEWALK SECTION

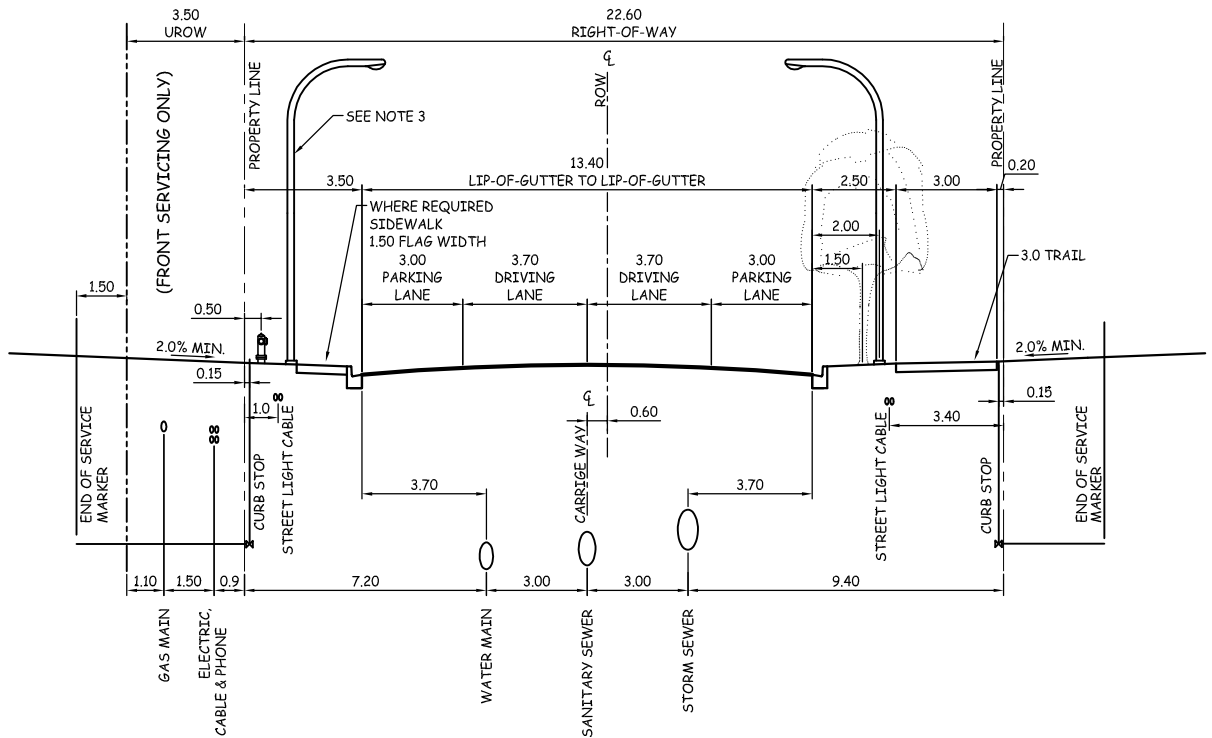

SEPARATE SIDEWALK (ALTERNATE) SECTION

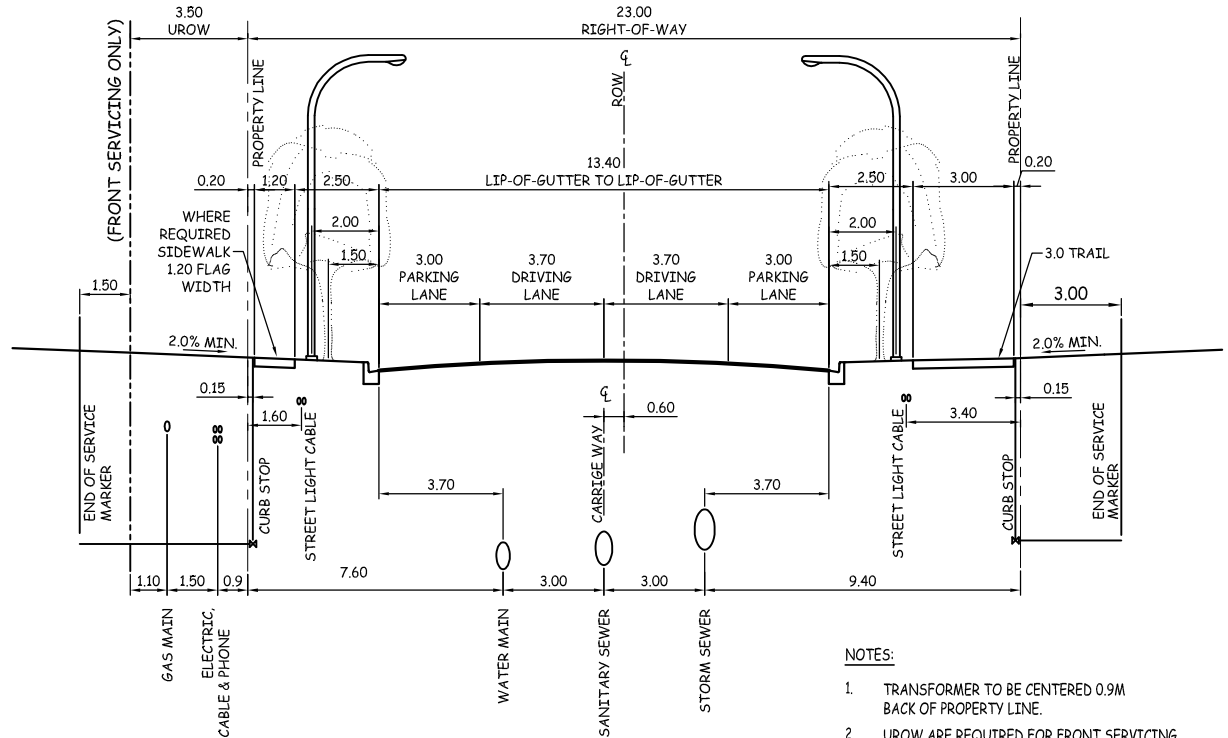

MINIMUM ROAD STRUCTURE

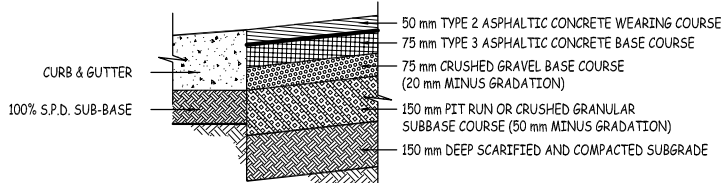

NOTES:

1. TRANSFORMER TO BE CENTERED 0.9M BACK OF PROPERTY LINE.
2. UROW ARE REQUIRED FOR FRONT SERVICING.
3. FOR MONOWALK ONLY- ALIGNMENT OF STREET LIGHT BASES TO BE ADJACENT TO BACK OF WALK
4. STREET LIGHT CABLES TO BE LOCATED AS SHOWN OR IN THE ELECTRICAL DISTRIBUTION TRENCH.
5. FOR SEPARATE SIDEWALK ONLY - FIRE HYDRANTS TO BE INSTALLED 1.50 METRES BEHIND LIP-OF-GUTTER (SAME ALIGNMENT AS TREE PLANTING)
6. ALL DIMENSTONS IN METRES, UNLESS OTHERWISE NOTED.

Authorized

Signature _____

Date _____

FILE: ROAD SECTIONS.DWG LAYOUT RD-112



Medicine Hat
The Gas City

Municipal Servicing Standard

MINOR COLLECTOR ROADWAY
(22.6m ROW - 13.4m TW)
INDUSTRIAL/COMMERCIAL AREAS

DWG NO. RD-109